


**TYPE "A" RELOCATION**

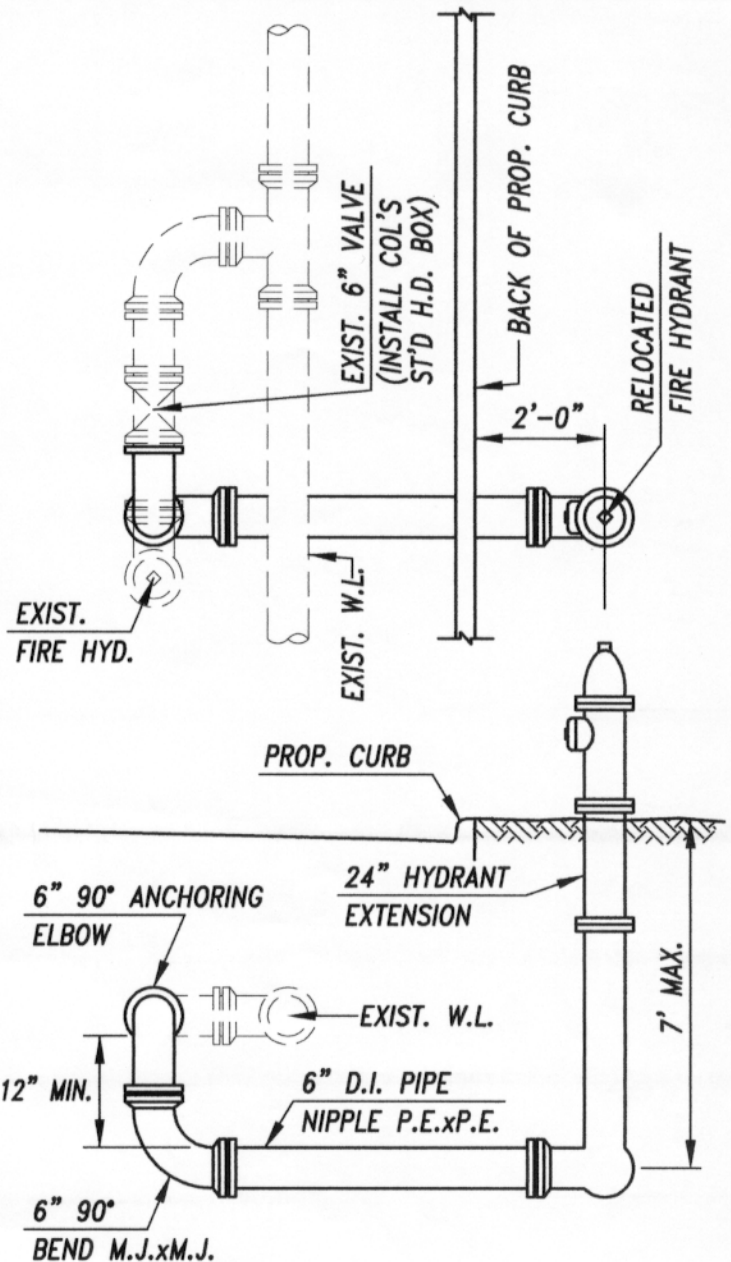

**TYPE "B" RELOCATION**

1. ALL FIRE HYDRANTS SHALL BE ADJUSTED TO FINAL GRADE.
2. FIRE HYDRANT RELOCATIONS SHALL CONFORM TO APPLICABLE SECTIONS OF C.M.S.C. ITEM 809. WORK SHALL CONSIST OF REMOVING HYDRANT, INSTALLING NEW 6" PIPE & FITTINGS AS REQUIRED TO SET HYDRANT 2'-0" BACK OF CURB OR 8'-0" OFF EDGE OF PAVEMENT, RESETTING HYDRANT AND BLOCKING AS REQUIRED.
3. THE DIVISION OF WATER SHALL BE NOTIFIED AT LEAST 48 HOURS PRIOR TO CONSTRUCTION INVOLVING WATER FACILITIES.
4. ALL EXISTING VALVES SHALL BE OPERATED BY DIVISION OF WATER PERSONNEL ONLY AS STATED IN CHAPTER 1113 OF THE COLUMBUS CITY CODES.
5. BACKFILLING OF ALL WATER LINE TRENCHES AND EXCAVATIONS SHALL BE IN ACCORDANCE WITH ITEM 801 OF THE C.M.S.C.. NO GRITS WILL BE PERMITTED IN WATER LINE TRENCH BACKFILL.

CITY OF COLUMBUS  
DEPARTMENT OF PUBLIC UTILITIES  
DIVISION OF WATER

APPROVED:

ENGINEER

DATE

STANDARD DETAIL  
TYPICAL  
HYDRANT RELOCATION

L-8502